



We help ideas meet the real world

DELTA Test Report



 **DANAK**
TEST Reg. no. 100

Measurement of reduction of Impact Sound Pressure Level for a Mira Flooring System type 4820 installed on a 140 mm Concrete Floor

Performed for Mira Byggeprodukter a/s

DANAK 100/1635

Project no.: T203896

Page 1 of 10

7 December 2012

DELTA

Venlighedsvej 4

2970 Hørsholm

Denmark

Tel. +45 72 19 40 00

Fax +45 72 19 40 01

www.delta.dk

VAT No. 12275110

Title

Measurement of reduction of Impact Sound Pressure Level for a Mira Flooring System type 4820 installed on a 140 mm Concrete Floor

Journal no.

DANAK 100/1635

Project no.

T203896

Our ref.

LOD/DH/ilk

Date of test

22 October 2012

Client

Mira Byggeprodukter a/s
Egegårdsvej 2
4621 Gadstrup
Denmark

Client ref.

Ole Romer

Summary

Laboratory measurements of the reduction of impact sound pressure level per one-third octave were carried out according to the test method of EN ISO 10140:2010 part 1, 3, 4 and 5 for Mira Flooring System type 4820 installed on a 140 mm concrete floor.

Test result evaluated according to EN ISO 717-2:1997 and EN ISO 717-2/A1:2006:

The weighted reduction of impact sound pressure level for the floor covering: $\Delta L_w = 19$ dB.

The report contains a description of the test specimen according to the client's specifications, a description of the mounting in the laboratory and the test results.

The test results per one-third octave are shown in tabular form and graphically on the graph sheet.

Descriptions of test rooms, test procedure, and evaluation methods are found in the Appendix.

Remark

The test results apply only to the objects tested.

DELTA, 7 December 2012



Leif Ødegaard
Acoustics



1. Introduction

At the request of Mira Byggeprodukter a/s a laboratory measurement was carried out of the reduction of impact sound pressure level for a Mira Flooring System type 4820 installed on a standard concrete floor.

2. Description of the Flooring based on the Client's Specifications

The Mira flooring system type 4820 has the following technical data:

The 4820 silent step underlay consists of a 1000 g/m² non-woven polypropylene, thickness approx. 9 mm covered with a thin layer of 4180 primer. On top the underlay is covered with 20 mm Mira floor levelling compound. Total thickness is 29-30 mm with a total weight of 35 kg m².

3. Mounting in the Laboratory

The flooring (approx. 10 m²) was installed on a 140 mm concrete floor slab mounted in a 2.99 m × 3.37 m test opening between two reverberant rooms.

The flooring was kept clear from the edges of the test opening.

The flooring was loaded by 10 uniformly distributed weights (approx. 25 kg each) corresponding to approx. 25 kg/m² in approx. 24 hours before the measurements were carried out.

4. Test Method

The measurements were carried out according to the test method of EN ISO 10140:2010 part 1, 3, 4 and 5: "Acoustics – Laboratory measurement of sound insulation of building elements".

The normalized impact sound pressure level of the concrete slab was measured with and without the floor covering.

The measurements were performed using a standardized tapping machine. The sound pressure level in the receiving room was measured using one-third octave band filters.

The test results are the difference between the measured normalized impact sound pressure levels of the standard floor without and with the floor covering.



The measurements were performed in room 004 and 904, Building 355 at the Technical University of Denmark. A brief description of the reverberant rooms and test procedures is found in the Appendix.

5. Instrumentation

The following instruments were used for the test:

Instrument	Type	A&V No.
Sound Level Frequency Analyser	B&K 2270	1498L
Tapping Machine	B&K 3207	1250L
Measuring Microphone	B&K 4144	1256L
Microphone Preamplifier	B&K 2619	857L
Microphone Power Supply	B&K 5935	1392L
Sensor for Temperature and Humidity	Elpro Ecolog TH1	1216L
Sound Level Calibrator	B&K 4231	1158L

6. Measurement Conditions

Date of tests and temperature and relative humidity in the source room during measurements with the floor covering:

Concrete floor without floor covering: Date of test: 15 October 2012

Concrete floor with the floor covering: Date of test: 22 October 2012, 18.3 °C, 55 % RH

The flooring was loaded by approx. 25 kg/m² during the measurements.

The tapping machine was placed in six positions on the floor under test.



7. Test Results

Reduction of impact sound pressure level according to EN ISO 10140-1:2010:

$$\Delta L = L_{n0} - L_n$$

where L_{n0} is the measured normalized impact sound pressure level of the standard floor without floor covering, and

L_n is the measured normalized impact sound pressure level of the standard floor with the floor covering.

The test result, ΔL , per one-third octave from 100 Hz to 5000 Hz is shown in tabular form and graphically on Graph Sheet 1.

The test result, ΔL_w , evaluated according to EN ISO 717-2:1997 and EN ISO 717-2/A1:2006:

The weighted reduction of impact sound pressure level for the floor covering: $\Delta L_w = 19$ dB.

The corresponding spectrum adaptation term: $C_{IA} = -12$ dB.

Description of the evaluation methods is found in the Appendix.



Normalized impact sound pressure level of the bare concrete floor of the laboratory:

Frequency [Hz]	$L_{n,0}$ dB re 20 μ Pa per one-third octave
100	66.3
125	66.9
160	70.6
200	72.2
250	69.7
315	70.1
400	71.6
500	72.2
630	72.4
800	72.9
1000	73.9
1250	73.5
1600	72.7
2000	72.4
2500	71.5
3150	70.7
4000	70.2
5000	68.7
$L_{n,0,w}$ dB	78

The weighted normalized impact sound pressure level of the reference floor used for the calculations of ΔL_w :

Reference floor without floor covering: $L_{n,r,0,w} = 78$ dB; $C_{I,r,0} = -11$ dB

Reference floor with the floor covering: $L_{n,r,w} = 59$ dB; $C_{I,r} = 1$ dB

8. Measurement uncertainty

According to DS/ISO 140-2:1992 precision of laboratory measurements expressed as the reproducibility of single-number quantities, including ΔL_w , will normally be in the range of 1 dB to 3 dB.



Laboratory Measurement of Reduction of Impact Sound Pressure Level according to EN ISO 10140-1:2010

Client: Mira Byggeprodukter a/s, Egegårdsvej 2, 4621 Gadstrup Denmark

Date of test: 22 October 2012

Description of the test specimen: Mira Flooring System type 4820. The thickness of the flooring is 29-30 mm and the weight is approx. 35 kg/m². The flooring was loaded by approx. 25 kg/m² during the measurements.


Test specimen mounted by: Mira Byggeprodukter a/s

Air temperature, source room: 18.3 °C

Air humidity, source room: 55% RH

Receiving room volume: 243 m³

Frequency f [Hz]	ΔL one-third octave [dB]
100	0.4
125	-0.5
160	-2.0
200	0.8
250	4.6
315	9.2
400	12.4
500	15.8
630	19.0
800	22.8
1000	25.8
1250	28.9
1600	31.6
2000	34.5
2500	36.9
3150	38.6
4000	39.1
5000	39.2

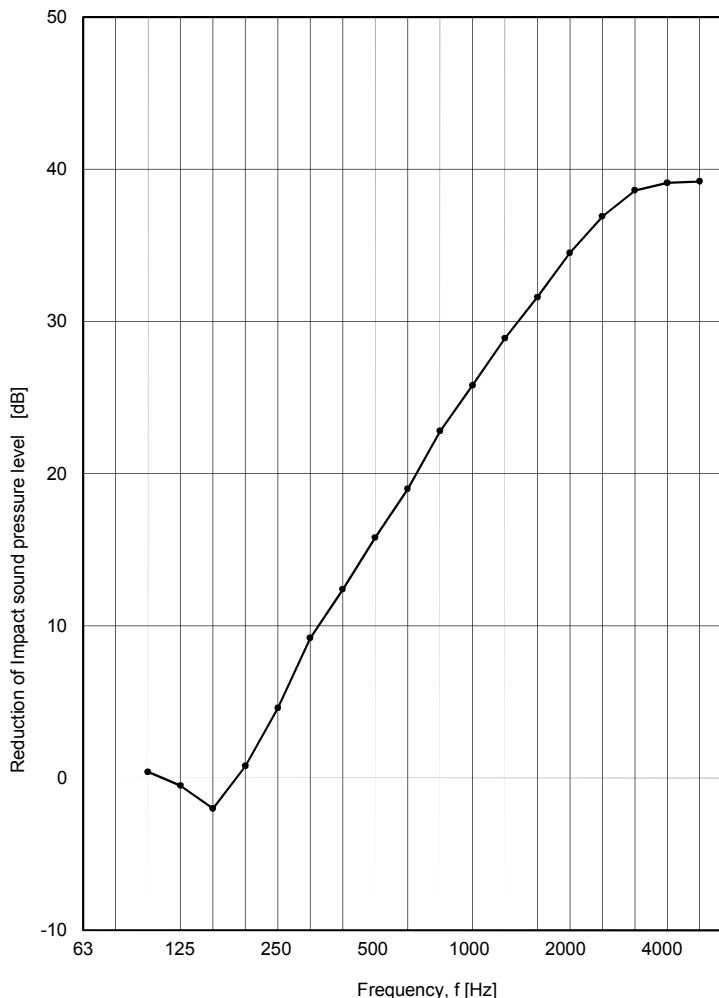

Weighted reduction of impact sound pressure level according to EN ISO 717-2:1997 and EN ISO 717-2/A1:2006:

$$\Delta L_w = 19 \text{ dB} \quad C_{1A} = -12 \text{ dB}$$

Evaluation based on laboratory measurement results obtained by an engineering method.

DELTA, 7 December 2012




Leif Ødegaard, Senior Specialist Acoustics




Description of Test Rooms

The measurements are performed in two reverberant rooms (004 and 009), one placed on top of the other. The length, width and height of the rooms are 7.85 m, 6.25 m and 4.95 m, respectively. The test opening between the rooms is 2.99 m × 3.37 m and has a depth of 0.65 m. In the upper room (004) sound diffusing elements of concrete and of damped steel plate are situated on two of the walls and on the ceiling. The volume of the room is approx. 230 m³. In the lower room (904), the volume of which is approx. 245 m³, 20 sheets of 10 mm acrylic (dimensions 0.90 m × 1.2 m) are used as sound diffusing elements.

When measuring the reduction of transmitted impact noise by floor coverings a standard floor, on which the test coverings are to be installed, is mounted in the test opening in the floor of room 004. The standard floor consists of a reinforced concrete slab of a thickness of 140 mm.

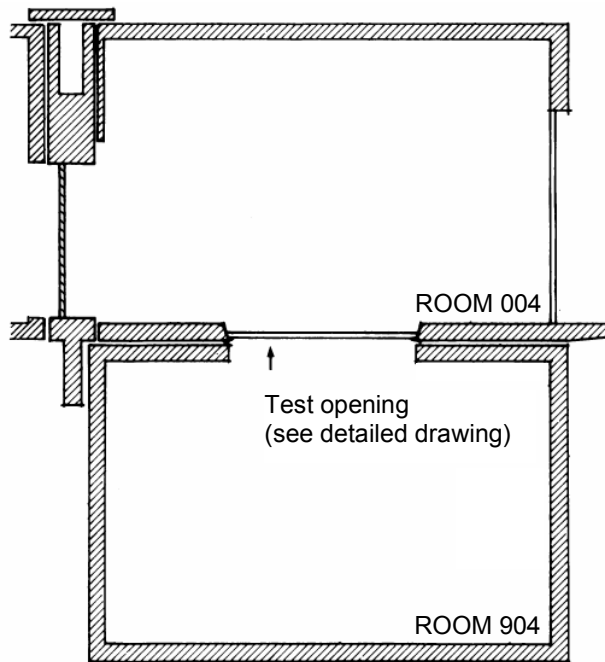

Test rooms.
Vertical section.
Scale 1:125.

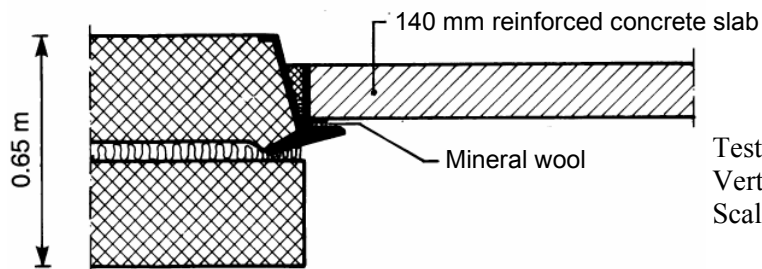

Test opening with standard floor.
Vertical section.
Scale 1:20.

Test Method

The reduction of impact sound pressure level according to EN ISO 10140-1:2010 by a floor or a floor covering measured on a standard floor in the laboratory is defined as the difference between the measured normalized impact sound pressure levels of the standard floor without and with the floor covering.

The normalized impact sound pressure level is defined as the sound pressure level in the receiving room when the floor under test is excited by the standardized tapping machine increased by a correction to a reference equivalent absorption area (10 m²) of the receiving room.

The measurements of the normalized impact sound pressure level are performed using a standardized tapping machine provided with steel hammers and meeting the requirements of EN ISO 10140-5:2010 Annex E. The tapping machine is adjusted in such a way that the falling height of the hammers on an even surface corresponds to a free fall from a height of 40 mm.

The tapping machine is placed in six positions on the floor under test, and the sound pressure level in the receiving room is measured using a moving microphone with a sweep radius of approx. 1.25 m and with an inclined plane of the traverse. The measurement is carried out using a real-time frequency analyzer with one-third octave band filters. The averaging time is 32 seconds corresponding to two traverses of the moving microphone. The total electrical and acoustic background noise level in the receiving room is measured. The sound pressure level in the receiving room is corrected for background noise, if affected. If the sound pressure level in the receiving room is less than 6 dB above the background noise level, this will be stated in the report together with an indication of the validity of the test results.

The equivalent absorption area of the receiving room is determined by means of Sabine's formula by measuring the reverberation time of the room in three microphone positions with two decays in each. The measurement of the reverberation time is performed with pink noise emitted by a loudspeaker system placed in a corner of the receiving room. The one-third octave filtered microphone signal is registered during the decay and evaluated in the range approx. 5 dB to approx. 25 dB below the steady-state level.

The normalized impact sound pressure level and the reduction of impact sound pressure level is determined within frequency bandwidths of one-third octave at the following standardized centre frequencies: 100, 125, 160, 200, 250, 315, 400, 500, 630, 800, 1000, 1250, 1600, 2000, 2500, 3150, 4000, and 5000 Hz.

$$L_n = L_M + 10 \log_{10} \cdot \frac{A_M}{A_0} \text{ and } A_M = \frac{0.163 \cdot V_M}{T_M}$$

where L_n = Normalized impact sound pressure level with a reference equivalent absorption area of 10 m² [dB re 20 µPa]



L_M = Sound pressure level in the receiving room when the floor under test is excited by the standardized tapping machine [dB re 20 μ Pa]

A_M = Equivalent sound absorption area in receiving room [m^2]

A_0 = Reference equivalent sound absorption area (10 m^2)

V_M = Volume of receiving room [m^3]

T_M = Reverberation time in receiving room [s]

$$\Delta L = L_{n0} - L_n$$

where ΔL = The reduction of impact sound pressure level resulting from installation of a test floor covering

L_{n0} = The measured normalized impact sound pressure level of the standard floor without floor covering

L_n = The measured normalized impact sound pressure level of the standard floor with the floor covering.

Evaluation Method

To evaluate the normalized impact sound pressure level of a floor the single-number quantity $L_{n,w}$ is used. The value is determined according to EN ISO 717-2:1997 and EN ISO 717-2/A1:2006.

When determining the evaluation value, $L_{n,w}$, the measured results of the normalized impact sound pressure level per one-third octave from 100 Hz to 3150 Hz are compared with a reference curve, which has a constant value from 100 Hz to 315 Hz, while it falls by 1 dB per one-third octave from 315 Hz to 1000 Hz, and by 3 dB per one-third octave from 1000 Hz to 3150 Hz. The values of the reference curve at the one-third octave centre frequencies are integers. An unfavourable deviation occurs at a certain frequency when the test result exceeds the value of the reference curve. The reference curve is shifted in steps of 1 dB until the sum of unfavourable deviations is as large as possible, but not more than 32.0 dB.

The $L_{n,w}$ -value is determined from the shifted reference curve as the value in dB at 500 Hz.

To evaluate the reduction of impact sound pressure level of a floor covering the single-number quantity ΔL_w is used. This value is determined according to EN ISO 717-2:1997 as well. The weighted reduction of impact sound pressure level, ΔL_w , is calculated as the difference between the $L_{n,w}$ -value of an idealized reference floor and the $L_{n,w}$ -value of the tested floor covering placed on the reference floor (normalized impact sound pressure level calculated using the measured improvements, ΔL , resulting from installation of the floor covering).

As an additional evaluation method based on a summation of the unweighted linear impact sound level the spectrum adaptation terms C_1 for the normalized impact sound pressure level and $C_{1\Delta}$ for the reduction of impact sound pressure level are defined in EN ISO 717-2:1997, Annex A.

